

Thermofuse O/O

Technical File
T 03006 C





DTP01

Description - General information

Pneumatic Thermal Trigger

Intrinsic energy device which is activated by a rise in temperature and does not need an external power supply to trigger and set in motion the SHEV on which it is installed.

When the temperature rises in the case of a fire, the glass phial containing alcohol shatters and releases the pin which then strikes the CO² cartridge. This means the SHEV can be activated autonomously.

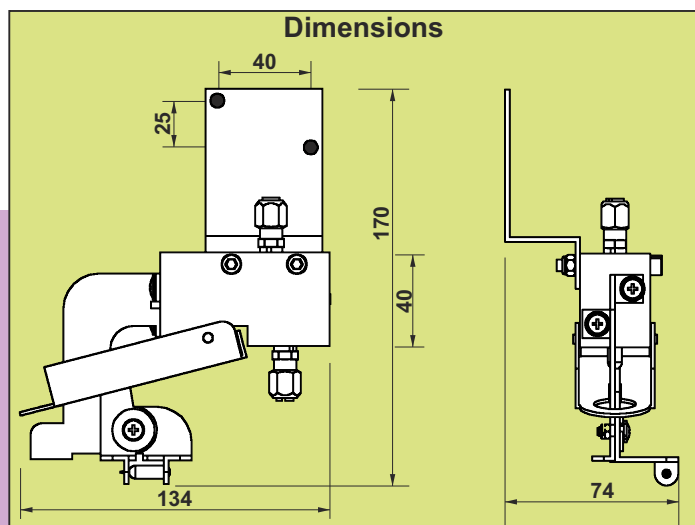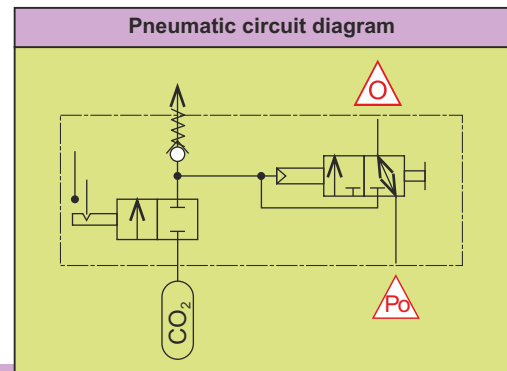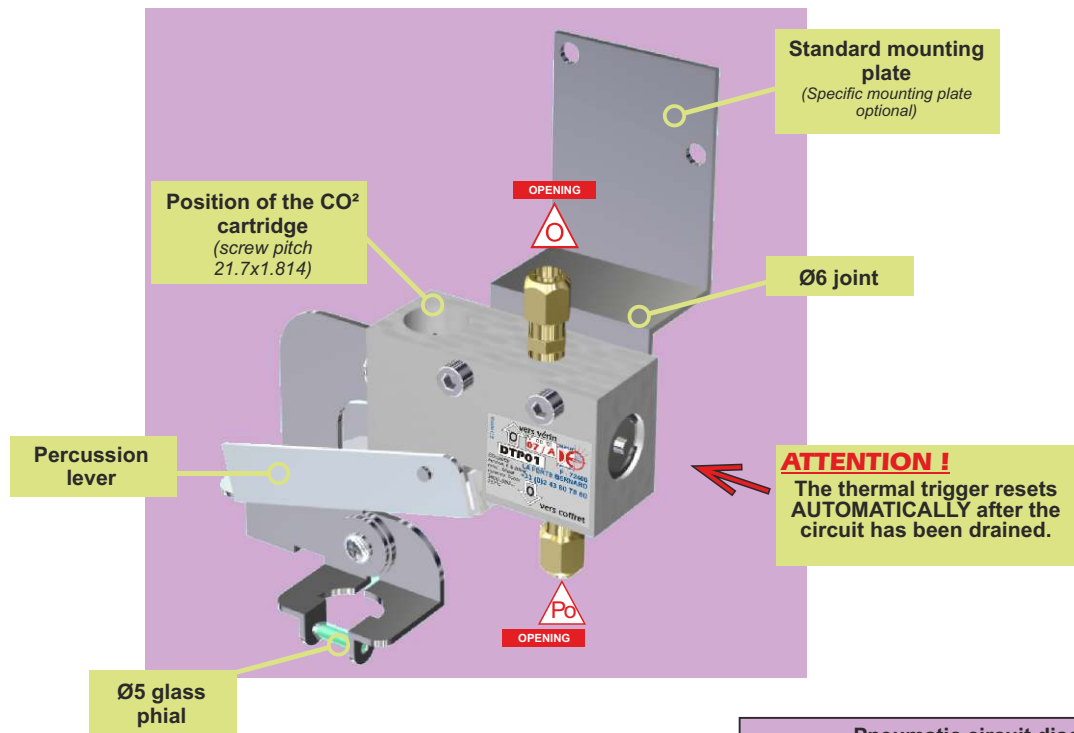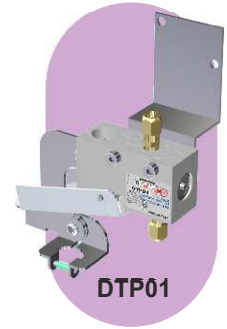

Cartridges must be screwed in place manually.

NF - Control devices for FSS
This label certifies :
- Conformity to norm NF S 61-938 for SCPs
- The values of the characteristics set out in this technical file.
Certification body
AFNOR Certification - 11 Rue F. de Pressensé
93571 LA PLAINE SAINT DENIS CEDEX

ALL RIGHTS RESERVED. OUR PRODUCTS MAY BE SUBJECT TO MODIFICATION. THEREFORE THIS DOCUMENT CANNOT BE CONSIDERED CONTRACTUAL. ALL MODELS ARE PATENTED. DO NOT LITTER THE PUBLIC HIGHWAY.

DUPUY EQUIPEMENTS

Les Ajeux - 72400 La Ferté Bernard - France
Tel. : +33 (0)2 43 60 78 60 - Fax : +33 (0)2 43 93 41 94
e-mail : clients@de72.fr



www.dupuy-equipements.com

DTP01

REMINDER :

Pipes and connections: § 7.2 of the NFS61-932

Pipes should be made entirely of copper or stainless steel. Connections should be airtight, metal against metal.

Pneumatic piping should run through the interior of the building, to avoid the risk of freezing.

Performance and testing: § 6.4 of the NFS61-932

The calculation to define the capacity required should be based on the characteristics of the components of the system to be fed and should take into account the characteristics of the circuit.

The pressure should be checked using a specialised tool (for example a pressure gauge) in order to make sure that the pressure present in the circuit corresponds to this calculation. In addition, this tool will check the airtightness of the circuit.

I

Installation


The thermal trigger should be installed as close as possible to the SHEV.

It should be mounted with the cartridge in a vertical position, the head facing downwards if the cartridge does not have a plunger tube.

Connect to the copper circuit.

Put the pipe into the joint, tighten manually and then with a spanner, until it is secure (1.5 turns maximum)


- Connect the entry and exit of the thermal trigger to the Open pneumatic circuit by the corresponding joints.

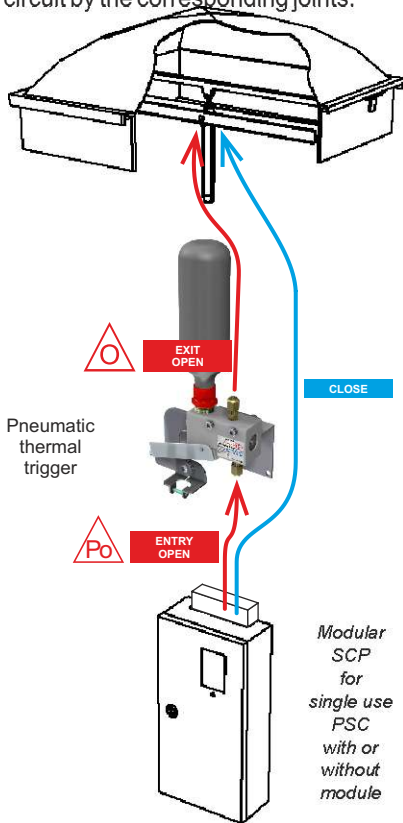

Example of use

Positioning of the glass phial containing alcohol.


Thermal trigger in triggered position. The pin is in the up position.

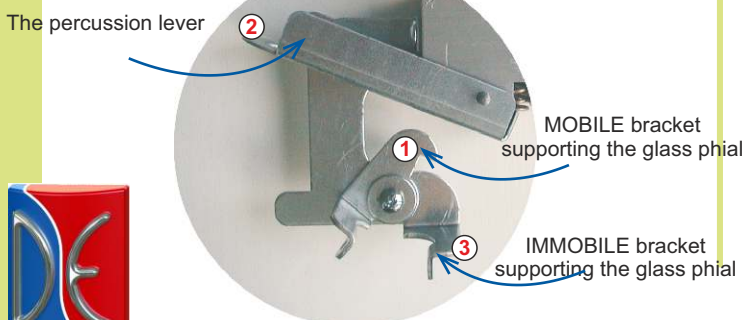


Turn the mobile bracke (1) towards the left.



Lower the percussion lev (2).

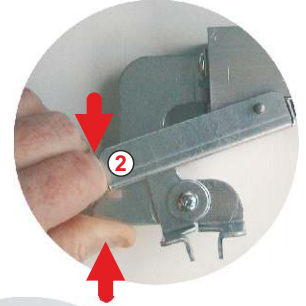

Holding the unit in this position, place either end of the glass phial into the support hole (1) on (3) the brackets and release gently .



Positioning of the glass phial containing alcohol.

Make sure that the pin is in the down position.

Put the CO² cartridge in place and screw on tightly **WITHOUT USING TOOLS.**



NOTE:

Cartridge 68° or 93°C according to requirements, head facing downwards if it does not have a plunger tube.

When this step has been carried out, the thermal trigger is back in stand-by position.

Resetting

After impact, clean the thermal trigger of any debris, glass or coloured liquid from the shattered phial. Then put the thermal trigger back in working order.

Maintenance

THE PRODUCT, every 6 months.

Check that everything is in good working order.

Check the condition of the pins.

INSTALLATION, see according to norm NFS61-933

Easy installation, useful material

To carry out the installation of this product, you will need the following:

Pressure control kit	KIP01
Copper piping	TCB506
Copper reel	TCC2506
Straight joint	RAU2621
T joint	RAU2623
Glass phial containing alcohol	AMP935
CO ² Cartridge	CARDE93.....

Technical Characteristics

Material	:Steel, brass, aluminium.
Protection	:Zinc coating
Energy	:Co ² or inert gas.
DCM entry and exit	: Olive screw connection
Temperature during use	: - 20°C to + 182°C
Pressure	:operating = 3 to 20 bar
	: in use = 60 bar
	: during testing = 90 bar.
CO ² cartridge pitch	21.7 x 1.814
Precautions	:Stock and install away from bad weather conditions.